




SECTION

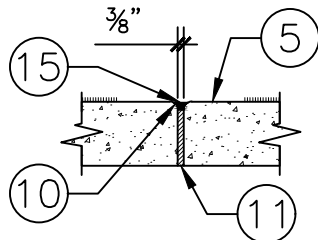

FULL DEPTH EXPANSION JOINT

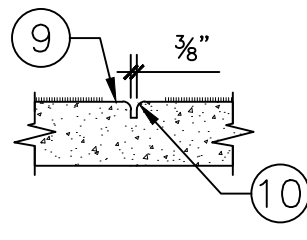

CONTROL JOINT

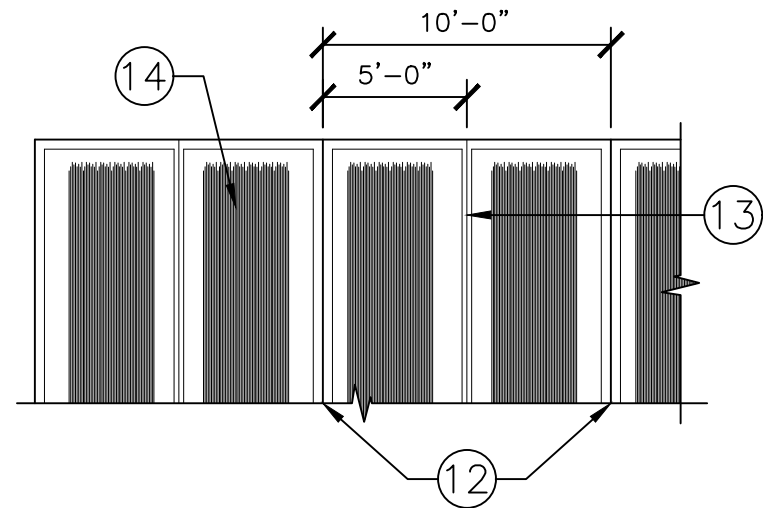

PLAN

- ① 3000 PSI CEMENT CONCRETE SLAB PER WSDOT 6-02
- ② 5/8" CRUSHED AGGREGATE PER WSDOT 9.03.9(3) COMPACTED TO 95% DENSITY
- ③ UNDISTURBED NATIVE MATERIAL
- ④ 1/2" RADIUS AT ALL PERIMETER EDGES, TYP.
- ⑤ 4" TOOLED EDGE AT ALL PERIMETER EDGES AND BOTH SIDES OF FULL DEPTH EXPANSION JOINTS, TYP.
- ⑥ 6"x6" WELDED WIRE FABRIC
- ⑦ BROOM FINISH
- ⑧ 0.5% MIN. SLOPE FOR POSITIVE DRAINAGE, 2% MAX. SLOPE FOR A.D.A. COMPLIANCE
- ⑨ 2" TOOLED EDGE AT BOTH SIDES OF CONTROL JOINTS, TYP.
- ⑩ 3/8"-1/2" RADIUS AT ALL JOINTS, TYP.
- ⑪ PREMOLDED JOINT FILLER
- ⑫ 3/8" FULL DEPTH EXPANSION JOINT AT 10'-0" O.C.
- ⑬ CONTROL JOINT CENTERED BETWEEN EXPANSION JOINTS
- ⑭ DIRECTION OF BROOM FINISH, TYP.
- ⑮ CAULK ALL FULL DEPTH EXPANSION JOINTS



City of  
Bellevue

TITLE:

CONCRETE - TYPICAL SLAB ON GRADE

DRAWING #:	PK-HS-05
SCALE:	N.T.S.
REVISION DATE:	12-2018
DEPARTMENT:	PARKS